


## Acoustic Test Report

**For:** 25mm Musiben Fabric Acoustic panels

**Mounted Method:** 25mm Musiben Fabric Acoustic panels + 50mm thick air gap

**Test Result:**

1/3 Octave Center Frequency (Hz)	100	125	160	200	250	315	400	500	630
Sound Absorption	0.3	0.38	0.49	0.62	0.73	0.86	0.94	1.03	1.04
1/3 Octave Center Frequency (Hz)	800	1K	1.25K	1.6K	2K	2.5K	3.15K	4K	
Sound Absorption	1.06	1.08	1.05	1.07	1.12	1.06	1.02	1	

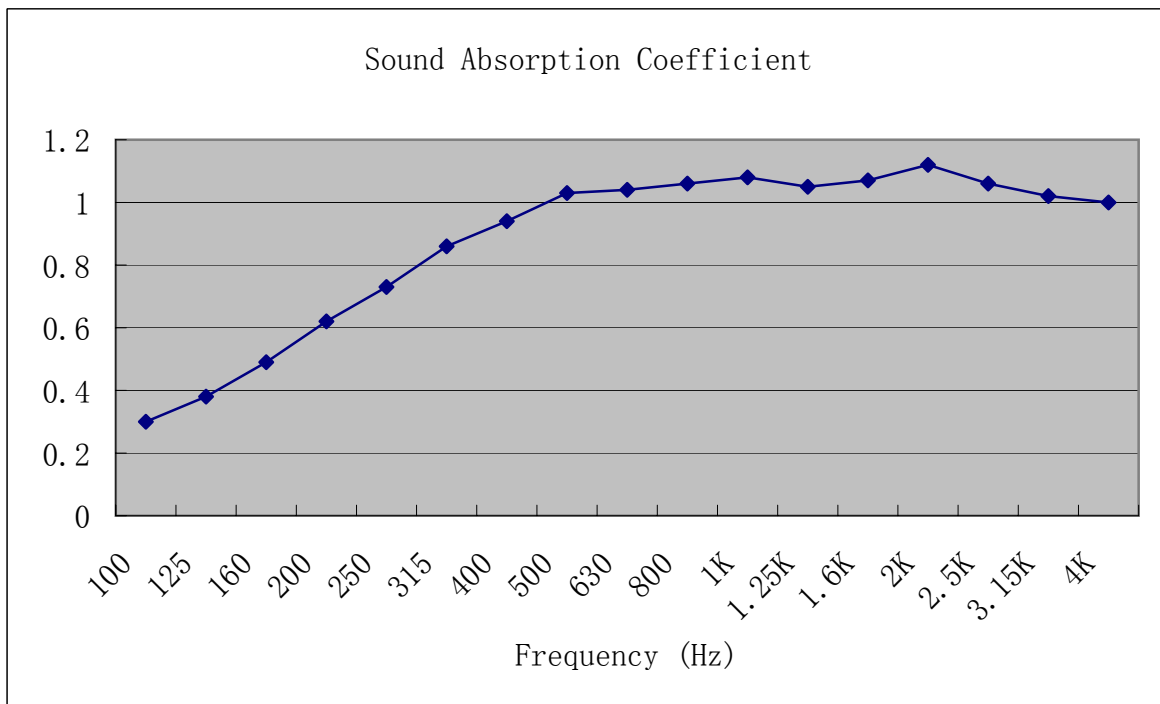

More information, please refer to [www.iacousticpanels.com](http://www.iacousticpanels.com)


## Acoustic Test Report

**For:** 50mm Fabric Acoustic panels

**Mounted Method:** 50mm Musiben Fabric Acoustic panels + 50mm thick air gap

**Test Result:**

1/3 Octave Center Frequency (Hz)	100	125	160	200	250	315	400	500	630
Sound Absorption	0.42	0.55	0.63	0.72	0.82	0.88	0.96	1.03	1.04
1/3 Octave Center Frequency (Hz)	800	1K	1.25K	1.6K	2K	2.5K	3.15K	4K	
Sound Absorption	1.03	1.08	1.07	1.06	1.00	1.02	1.00	0.96	

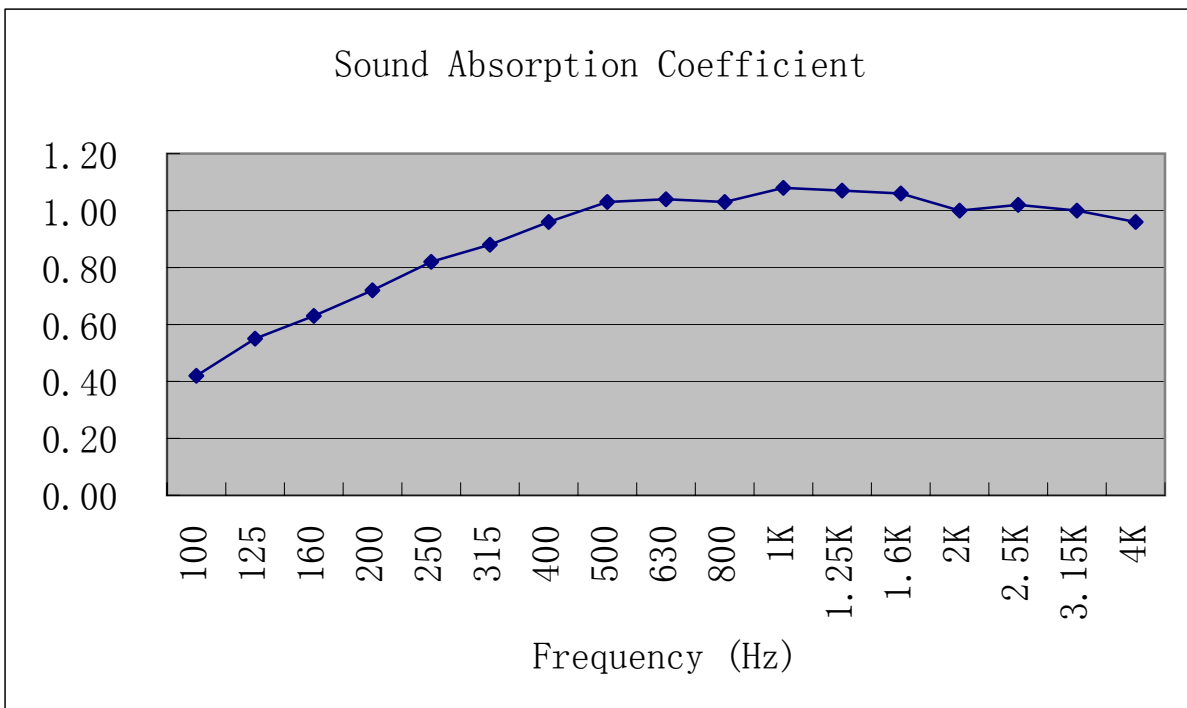

More information, please refer to [www.iacousticpanels.com](http://www.iacousticpanels.com)